

Average Arsenic in the Grand Canyon Region

Coconino Aquifer Wells and Springs

40 well and spring sites in the Grand Canyon region were sampled for arsenic


4 wells had average arsenic levels above the EPA's safe drinking water limit

3 of those wells are located at the Pinyon Plain Uranium Mine

Average Arsenic Levels, 1993-2025

59 µg/L

≤10 µg/L
the EPA safe drinking water limit

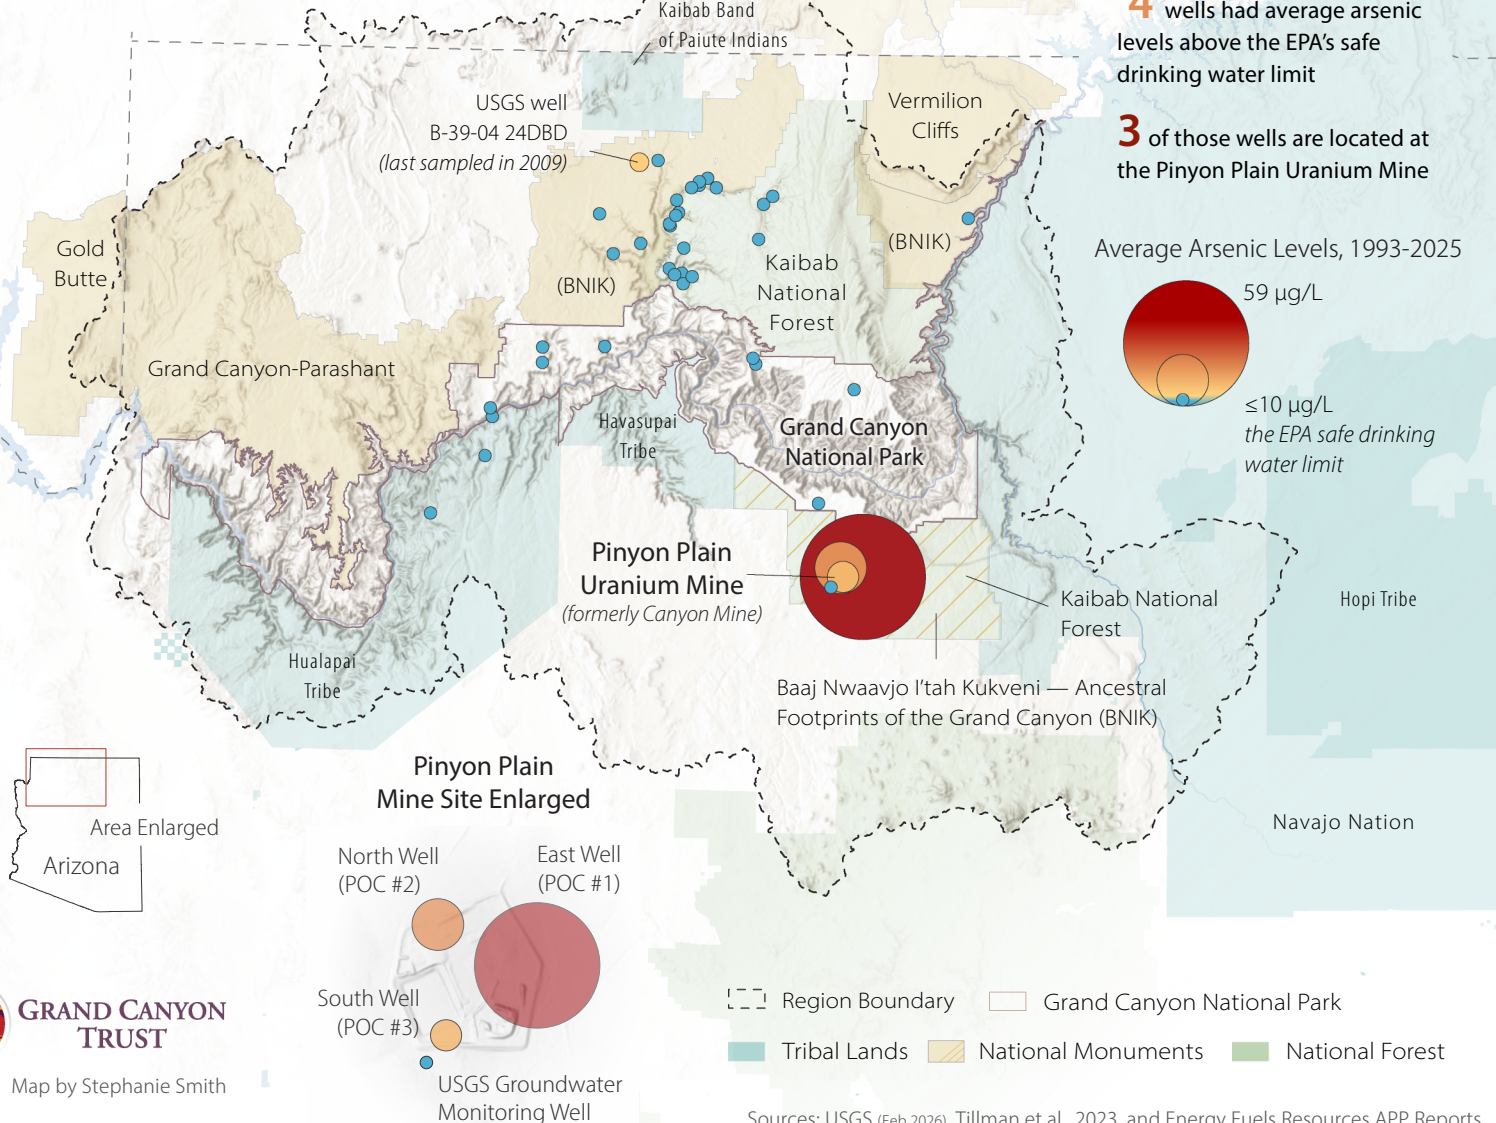

GRAND CANYON TRUST

Map by Stephanie Smith

Sources: USGS (Feb 2026), Tillman et al., 2023, and Energy Fuels Resources APP Reports

Map updated 9/22/2026